


PARKER BLOWDOWN COOLING ASSEMBLY INSTALLATION DRAWING

NOTES:

- 1.) BLOWDOWN COOLING ASSEMBLY IS SHOWN DOUBLE LINE, FIELD PIPING IS SHOWN SINGLE LINE.
- 2.) COOLING ASSEMBLY IS FACTORY ASSEMBLED & SHIPPED NOT ATTACHED TO TANK. UNIT MUST BE SCREWED ONTO BLOWDOWN TANK OUTLET.

VENT THRU ROOF INDEPENDENTLY ROUTED, FULL SIZE

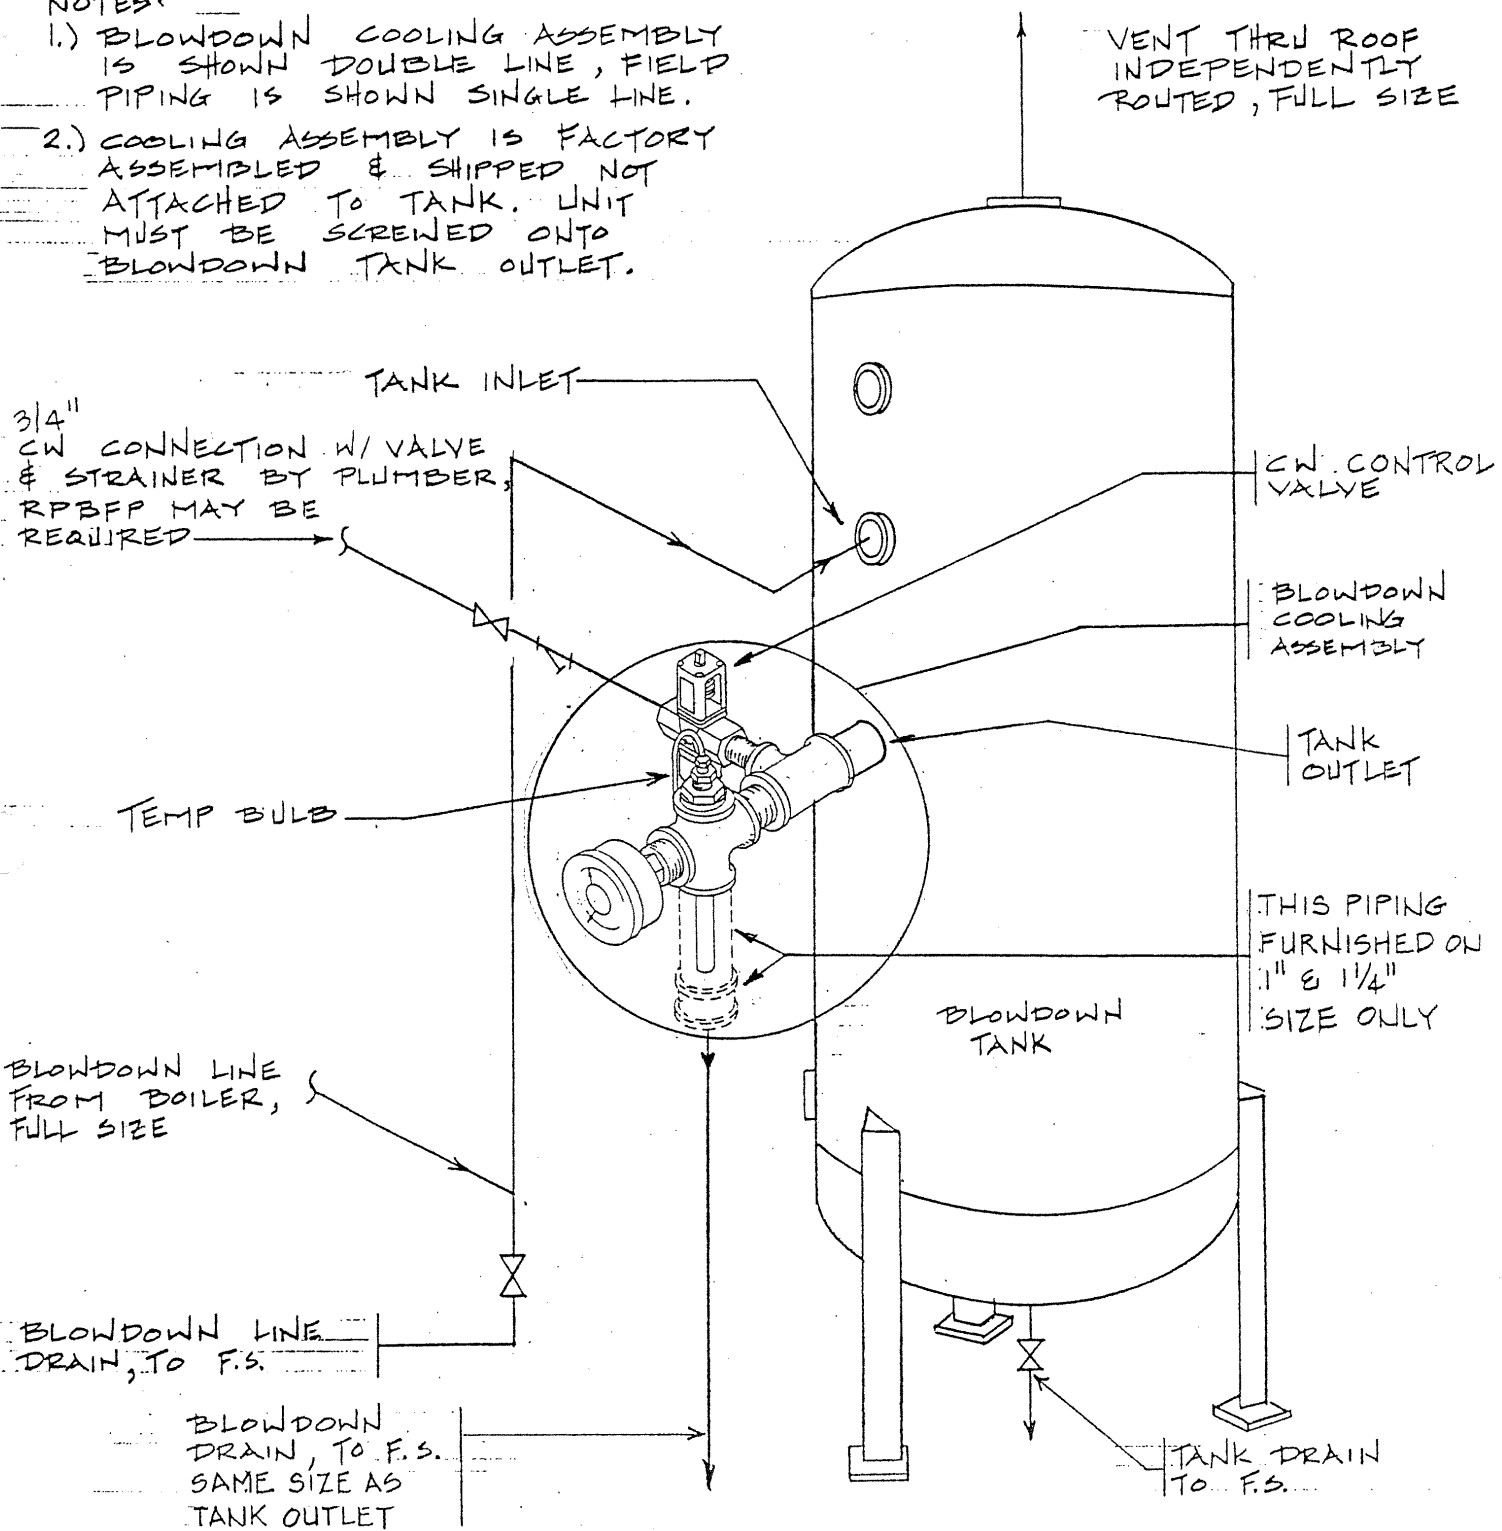

USED ON BLOWDOWN TANKS	PART NAME BLOWDOWN COOLING ASSEMBLY
FOR INSTALLATION	

MSL	DATE 5/92
CH.	
APPROVED	

PARKER BOILER CO.
5930 BANDINI BLVD.
LOS ANGELES, CALIF. 90040-2999

SCALE	NONE
SUPERCEDES NO.	4/92 4/88
DWG. NO.	A-115-BDCA-INST.